

Asbestos Abatement Project Design

**439 South 2nd Street
Montrose, Colorado**

July 16, 2015



**ASBESTOS ABATEMENT PROJECT DESIGN
STRUCTURE FOR RENOVATION
439 SOUTH 2nd STREET
MONTROSE, COLORADO**

Prepared for: Mr. Mark Armstrong
Facilities Manager
City of Montrose
433 South 1st Street
Montrose, CO 81401



Reviewed by:

Jake Harris, APCD# 16493
Project Manager



Prepared by:

Travis Brophy, APCD# 13477
Certified Asbestos Inspector/Designer



TABLE OF CONTENTS

1	INTRODUCTION	1
2	REGULATORY CONSIDERATIONS	1
3	SCOPE OF WORK	2
4	SPECIAL CONSIDERATIONS	3
5	WORK PROCEDURES	5
5.1	Asbestos Abatement Procedures – Full Containment	5
5.2	Asbestos Abatement Procedures – Window Caulking	7
5.3	Full Containment Clearance Procedures	8
5.3.1	Pre-Clearance Inspection.....	8
5.3.2	Clearance Air Monitoring.....	8
6	SCHEDULE	8

LIST OF APPENDICES

APPENDIX A.....	FIGURES
APPENDIX B.....	INSTRUCTION TO BIDDERS & BID FORM



ACRONYMS AND ABBREVIATIONS

ACM	asbestos-containing materials
AHERA	Asbestos Hazard Emergency Response Act
AMS	air-monitoring specialist
CDPHE	Colorado Department of Public Health and Environment
Contractor	Contractor awarded the bid
EPA	Environmental Protection Agency
GRE	Grande River Environmental, LLC
HEPA	high-efficiency particulate air
OSHA	Occupational Safety and Health Administration
Owner	City of Montrose
PCM	phase-contrast microscopy



ASBESTOS ABATEMENT PROJECT DESIGN

STRUCTURE FOR RENOVATION 439 SOUTH 2nd STREET MONTROSE, COLORADO

1 INTRODUCTION

Grande River Environmental, LLC (GRE) was contracted by the City of Montrose (Owner) to prepare a Project Design document for the abatement of asbestos-containing materials (ACM) from the structure located at 439 South 2nd Street in Montrose, Colorado. The purpose of these specifications is to provide details regarding the location and extent of identified ACMs, removal methods, and regulatory requirements for asbestos abatement. Asbestos-containing materials were identified during building an inspection conducted by GRE. The structure is planned for renovation; therefore, all friable and selected non-friable ACMs must be removed from the structure if the area is planned to be impacted by renovation.

2 REGULATORY CONSIDERATIONS

Personnel abating ACM must be certified by the Environmental Protection Agency (EPA) and the Colorado Department of Public Health and Environment (CDPHE). The Contractor shall assume full responsibility and liability for complying with all applicable federal, state, and local regulations pertaining to work practices, hauling, disposal, and protection of workers, visitors to the site, and persons occupying areas adjacent to abatement activities. The Contractor is responsible for providing medical examinations and maintaining medical records of personnel as required by the applicable Occupational Safety and Health Administration (OSHA) regulations. The Contractor shall hold the Owner and GRE harmless for failure to comply with any applicable work, hauling, disposal, safety, health or other regulations on the part of the Contractor, the Contractor's employees, or subcontractors. Where conflict between the regulations and this scope of work document exists, the most stringent requirements shall be followed.



3 SCOPE OF WORK

Various ACMs were identified in the structure. Descriptions and locations of each of the materials are presented in Table 1.

TABLE 1 - MATERIALS SCHEDULED FOR ABATEMENT

Material Description	Location/ Comments	Approximate Amount
439 South 2nd Street		
2'x 4' Ceiling Tiles	Throughout basement	1,360 ft ²
Mediterranean Pattern Linoleum	Basement woman's restroom installed on concrete	20 ft ²
12"x 12" Tan Marble Pattern Floor Tiles and Mastic	Northwest portion of basement installed on concrete. Floor tiles and mastic are beneath approximately 50 lf of wood framed walls	255 ft ²
Drywall with Joint Compound and Texture	Majority of walls throughout the structure some texture is present behind wallpaper and wood paneling	7,744 ft ²
Popcorn Ceiling Texture	Throughout main level	1,360 ft ²
Window Caulking	South side around door frames and window frames	60 lf

The Contractor shall be responsible for the removal of all materials necessary to facilitate abatement. Materials potentially contaminated with asbestos (e.g. – carpeting adhered to linoleum, insulation, etc.) shall be disposed as asbestos waste. A summary of the removal requirements is presented below.

439 South 2nd Street

2'x4' Ceiling Tiles, Mediterranean Pattern Linoleum, 12"x12" Tan Marble Pattern Floor Tiles and Mastic, Drywall with Joint Compound and Texture, and Popcorn Ceiling Texture – Will be removed within a full containment under negative air pressure of at least negative 0.020 inches of water. All removed materials and debris generated during removal (including but not limited to insulation) shall be properly packaged, labeled, and disposed as asbestos waste. Removal operations shall be completed in one contiguous containment.

Window Caulking – Located on the south basement level windows and door is non-friable in its current condition. The windows and door caulking may be removed utilizing minimal engineering controls in accordance with Section III.S.4 of Regulation No. 8. If the window caulking will be rendered friable during removal, the material shall be abated within a full containment under negative air pressure of at least 0.02 inches of water. The abated work areas will be subjected to a final visual inspection. All removed materials and debris generated during removal shall be property packaged, labeled, and disposed as asbestos waste.



A GRE air-monitoring specialist (AMS) certified by EPA and CDPHE will conduct a final visual inspection and clearance air monitoring at the conclusion of abatement activities in each work area. The Contractor shall contact the AMS a minimum of 24 hours prior to applying encapsulant for a final visual inspection. Clearance air monitoring will be completed within 48 hours after the final visual inspection and application of the encapsulant. In the event that the AMS arrives on-site at the request of the Contractor and the area is identified to require extensive additional cleaning or that the encapsulant requires additional drying time, the cost of the additional time required for the AMS will be reduced from the contract amount by the Owner to compensate the AMS. **A minimum of 5 samples and 2 blanks will be collected from each work area and will be analyzed by phase-contrast microscopy (PCM) by an accredited laboratory.**

The locations of ACM to be removed are described in Table 1 and shown on figures 1 through 4. Quantities listed on the drawings are approximate and are for general information only; therefore, the Contractor is responsible for verifying actual site conditions. Variance from these quantities shall not be justification for a revision of the contract amount. By submitting a bid, the Contractor acknowledges that he has investigated and is satisfied with:

- A. The conditions affecting the work, including but not limited to, physical conditions which otherwise may affect performance of required activities.
- B. The character and quantity of all material to be removed.
- C. Project scheduling and coordination.
- D. All other aspects of implementing the project.

4 SPECIAL CONSIDERATIONS

The following special considerations shall be followed by the abatement contractor during removal activities.

- A. Notices shall be provided to the CDPHE for each structure that will require the removal of more than 260 linear feet, 160 square feet, or the volume equivalent of a 55-gallon drum of friable ACM; therefore, the Contractor shall acquire an asbestos permit from the CDPHE for the structure.
- B. The guidelines specified in Colorado Regulation No. 8 shall be followed by the Contractor. In addition to this requirement, the Contractor shall also comply with other requirements specified in EPA, OSHA, state, and local requirements and regulations.
- C. The Contractor shall comply with the abatement sequence specified in Section III.H of Regulation No. 8.
- D. Electricity, water, and sanitary sewer will be available for contractor use at the structure.



E. All makeup air for the work area shall be directed through the waste loadout and decontamination unit. Negative air machines shall be installed in the work area in an arrangement to maximize the airflow in each work area.

F. The movement and handling of all movable objects and surfaces within specified areas are within the scope of work. All porous materials, including but not limited to: fiberglass insulation, loose drywall, carpet, and loose porous wood shall be removed and disposed as asbestos-containing waste or decontaminated and isolated from the work area using critical barriers. All loose non-porous materials including, but not limited to: metal, glass, non-porous wood and plastic shall be decontaminated and removed from the area or isolated from work procedures. The Owner shall designate an area for storage of these non-porous materials (e.g. room or dumpster).

G. Exhaust filtration machines shall be ducted to exterior sides of the building in an inconspicuous manner. Filtration machines will not be exhausted to the interior of the buildings.

H. The use of protective equipment including respirators, boots, hoods, and gloves (such as leather, latex, or nitrile) in compliance with applicable regulations is mandatory at all times.

I. Provide temporary "hard walls" where the enclosure(s) or staging area(s) will be exposed to publicly-accessible areas. Where no permanent walls exist, the Contractor shall construct walls with metal or wood studs covered with one layer of 1/2" plywood on the side facing the public.

J. No items, equipment, tools, or elements of construction other than ACM waste shall be removed or disposed of without prior written permission from the Owner.

K. The Contractor is responsible for removing fixtures, fixed objects, structural enclosures (walls, ceilings, chases, etc), equipment and related components, and other items that may be required to facilitate abatement activities (i.e. installation of exhaust, access to ACM, etc.).

L. Polyethylene sheeting shall be affixed in a manner that will ensure it will remain in position throughout the length of the project. Any tears in the polyethylene sheeting shall be immediately repaired. The Contractor shall inspect spaces adjacent to the containment and shall seal any visible penetrations leading to the containment area.

M. Where specified or authorized by the Owner, (if due to project limited staging area, limited scope of work, etc), follow CDPHE requirements, by separating the Clean Room, Shower Room, and Equipment Room using sheet plastic flapped doorways.

For purposes of compliance with CDPHE regulations, CDPHE interprets an air-lock to mean a space or flapped doorway. Flapped doorways may be treated as an air-lock, resulting in true 3-chambered decontamination units.



N. The Owner will not attempt to enforce compliance with the specifications or applicable federal, state, or local regulations; however, the Owner reserves the right to stop asbestos abatement work when observed work practices are not in compliance with such laws, regulations, and requirements. Safety of the project area for the protection of the Contractor, the Owner, and the general public is the responsibility of the Contractor. The Contractor is solely responsible for evaluating compliance with all applicable laws and regulations.

O. Staging areas for equipment and personnel will be determined by the Owner. Security for any equipment and/or trucks left onsite is the responsibility of the Contractor. The Owner and Consultant will not be responsible for theft or vandalism of Contractor's equipment.

P. The quantities identified herein are approximate. The Contractor is responsible for verifying material quantities and site conditions. Variance from these quantities shall not be justification for a revision of the contract amount. Any discrepancies or omissions must be brought to the attention of the Owner prior to submitting a bid. By submitting a bid, the Contractor agrees with all conditions for completing the work including general work areas, quantities, schedules and procedures.

Q. Final visual inspection and clearance air monitoring will be conducted by GRE on Monday through Friday from 8:00 am to 2:00 pm. Inspection and monitoring activities will not be started later than 2:00 pm and must be able to be completed by 6:00 pm otherwise activities will be delayed to the next available weekday.

5 WORK PROCEDURES

All materials which require removal within a full containment are outlined in the procedures specified in Regulation No.8 and Section 5.1 of this document.

5.1 Asbestos Abatement Procedures – Full Containment

The following sequence of abatement activities shall be followed during removal operations that are required to be completed within a full containment in the order listed below unless a variance request is approved by the CDPHE and GRE and a copy of the approval is provided to the Owner. Work must be completed in accordance with all applicable federal, state, and local rules and regulations. In the event that there is a conflict in regulatory requirements and these specifications, the Contractor shall comply with the most stringent standard.

A. Install Critical Barriers – Critical barriers shall be installed over all openings between the work area and clean area to isolate the work area from the remainder of the structure. Critical barriers shall include 6-mil polyethylene sheeting affixed on all sides with spray glue and duct tape.

B. Establish Negative Pressure – Negative air machines equipped with high-efficiency particulate air (HEPA) filters shall be installed into the work area. The number of negative-air



machines installed shall be sufficient to maintain a pressure differential of negative 0.02 inches of water and complete 4 air changes per hour. The units shall be exhausted to the exterior of the building and air flow direction shall be directed from outside the work area to the inside of the work area.

C. Construct the Decontamination Unit – A decontamination unit shall be constructed to include a clean room, shower, and equipment room leading into the work area. All personnel entering or exiting the work area shall do so through the decontamination unit.

D. Pre-Clean Surfaces – All surfaces inside the work area shall be pre-cleaned utilizing HEPA vacuuming and wet wiping methods. Collected dust and debris and cleaning supplies shall be disposed as asbestos waste.

E. Covering Fixed Objects – All fixed objects shall be covered with a minimum of 1 layer of 6-mil polyethylene sheeting.

F. Containment Construction – Floors shall be covered (where appropriate) with a minimum of 2 layers of 6-mil polyethylene sheeting. Floor sheeting shall extend up sidewalls at least 12 inches and be sized to minimize seams, with no seams located along the wall/ floor intersection. Walls shall be covered (where appropriate) with sheeting that shall consist of 2 layers of 4-mil or thicker polyethylene sheeting. Wall sheeting shall extend beyond wall/floor, wall/ceiling, and wall/wall intersections at least 12 inches and shall be sized and oriented to minimize seams. Ceilings shall be covered (where appropriate) with 1 layer of 4-mil or thicker polyethylene sheeting. Ceiling sheeting shall extend beyond the wall/ceiling intersection at least 12 inches and shall be sized to minimize seams. The containment will also be equipped with at least 1 12”x12” view port and a waste load-out area. The view port shall be installed in a location to maximize the viewing area inside each work area. The waste load-out unit shall be constructed separate from the decontamination unit and shall be used as a temporary storage area for bagged waste and as a port for transferring waste to the transport vehicle.

G. Conduct Abatement – Removal of the specified materials will include the use of wet methods, HEPA vacuuming, and wet wiping. Airless sprayers shall be used to apply amended water to all ACM before removal is attempted. All waste shall be kept adequately wet with amended water until bagged for disposal. Surfactants must be a commercially available product specifically designed to be mixed with water for use in wetting of ACM. Removed materials shall be immediately placed into 6-mil polyethylene bags after removal. Bags shall be immediately sealed when full. Waste shall be periodically transported out of the work area into the transport vehicle through the waste load-out. Prior to removing the waste from the work area, the waste shall be sealed in 2 layers of 6-mil polyethylene sheeting or bags and appropriate labels shall be affixed to the bags.

H. Conduct Final Visual Inspection – The final visual inspection shall be completed by a GRE certified AMS. The inspection shall be completed with only critical barriers remaining in place to determine whether all dust and debris has been removed from the work area and from behind



critical barriers. Spray encapsulant may be applied after completion of the final visual inspection. Any carpeting present in the work area will be exposed during the final visual inspection.

I. Final Clearance Air Monitoring – At the conclusion of the final visual inspection and after an adequate drying time has elapsed for the encapsulant, the GRE AMS will conduct final clearance air monitoring. Monitoring will be completed aggressively using box fans and a leaf blower to create a turbulent atmosphere inside the work area. A minimum of 5 samples and 2 blanks will be collected from the interior of each work area. Samples will be analyzed by an accredited laboratory by PCM analysis. Results will be compared to the clearance standard of 0.01 fibers per cubic centimeter.

J. Containment Tear-Down – The containment will be dismantled upon receipt of sample results indicating that airborne asbestos concentrations are below the clearance standard.

K. If clearance air samples exceed the clearance standard, the Contractor shall at his own expense re-clean the area and the Owner shall deduct the cost of the additional clearance samples from the final contract payment.

5.2 Asbestos Abatement Procedures – Window Caulking

In accordance with Sections III.S.4 of Regulation No. 8, removal of the asbestos-containing caulking may be removed utilizing minimal engineering controls so long as the material remains non-friable during removal activities. In the event that the material cannot be removed in a non-friable condition, the material must be removed within a full containment in accordance with Section 5.1. A summary of the work procedures are presented below.

A. Preparation – The following activities shall be completed prior to beginning removal activities.

1. Remove all objects from the work area that may hinder removal.
2. Install drop cloths in the work area.
3. Wet all material with amended water.

B. Removal – The following activities shall be completed during removal. Window caulking must be removed by hand methods. Scrappers, picks, and wet clothes can be used to remove the caulking from the adjacent metal frame.

C. Final Cleaning – Upon completion of the removal activities, collect all remaining dust and debris present in the work area. Collected dust and debris and cleaning supplies shall be disposed as asbestos waste.

D. Conduct Final Visual Inspection – The final visual inspection shall be completed by a GRE air-monitoring specialist (AMS) certified by the CDPHE. The inspection shall be completed to determine whether all caulking has been removed from the work area.



5.3 Full Containment Clearance Procedures

Upon completion of the abatement action and application of the encapsulant in areas where removal was completed within a full or secondary containment, a pre-clearance inspection and clearance air-monitoring will be completed. The inspection and sampling will be conducted by a certified AMS. To determine if airborne asbestos concentrations have been reduced to below the maximum allowable asbestos level, the AMS will obtain samples and have them analyzed in accordance with EPA and Colorado regulations.

5.3.1 Pre-Clearance Inspection

Following the completion of clean up and lockdown operations, the Contractor shall notify the AMS that the work area is ready for clearance air-monitoring with 24 hours notice. At the conclusion of the abatement action and with only critical barriers still in place, the AMS will visually inspect the work area, determine whether all dust and debris has been removed, and evaluate if the lockdown/encapsulant has completely dried and a sufficient settling period has elapsed. When critical barriers are removed for inspection purposes, the area behind the critical barrier shall be cleaned and the critical barrier immediately replaced by the Contractor. In the event that the AMS identifies areas requiring additional cleaning, the contractor shall re-clean the area at no expense to the Owner.

5.3.2 Clearance Air Monitoring

The AMS shall collect air samples using aggressive techniques as described in 40 CFR Part 763 Appendix A of Subpart E using a leaf blower and box fans to suspend dust and keep the work area atmosphere in a turbulent state. Workers performing the aggressive sampling procedures will remain in appropriate protective clothing and respirators at all times. Stationary fans shall be placed in locations where they will not interfere with air monitoring equipment. Fans shall be directed towards abated surfaces. One fan shall be used for each 10,000 cubic feet of work space. All surfaces in the workspace will be swept with the leaf blower. In accordance with Asbestos Hazard Emergency Response Act (AHERA) and Regulation No. 8, a minimum of 5 samples will be collected from each work area.

Samples will be analyzed by a certified laboratory for PCM analysis. The contractor will allow 24 hours for sample collection and reporting of results by the AMS. The initial sampling will be conducted at the expense of the Owner. Sample results will be compared to the PCM clearance standard of 0.01 fibers per cubic centimeter.

6 SCHEDULE

A contractor walkthrough will not be held for the project. Scheduling will be based on the City of Montrose scheduling.



SUBMITTALS

The following submittals shall be required at the specified intervals. Required submittals shall be submitted to the Owner and copies shall be submitted to the Owner's Representative. Contact information for providing submittals is listed below.

Bidder Information (Due with Submittal of Bids)

Bid Form
General Abatement Certificate
Insurance Certificate(s)

On-Site Documents (Available for Review during Removal)

Respiratory Protection Program
Hazard Communication Program
Medical Response Program
Labor Postings

Pre-Start Submittals (Due upon Award of Contract)

Proposed Disposal Facility Information
List of Personnel with Certifications

Contract Closeout (Due Two Weeks after Completion)

Disposal Manifests
Summary of Change Orders
Daily Logs
Daily Entry/ Exit Sign-in Sheets
Visitor Documentation Forms
24-hour Manometer Chart
OSHA Air Monitoring Results
Accident Reports

SUBMITTAL CONTACT INFORMATION


OWNER:
Mr. Mark Armstrong
Facilities Manager
City of Montrose
433 South 1st Street
Montrose, CO 81401

OWNER'S REPRESENTATIVE:
Mr. Jake Harris
Project Manager
Grande River Environmental, LLC
562 Huntington Point Lane
Clifton, CO 81520
(970) 970-201-9731 phone
Jakeh@GrandeRiverenv.com



APPENDIX A

FIGURES

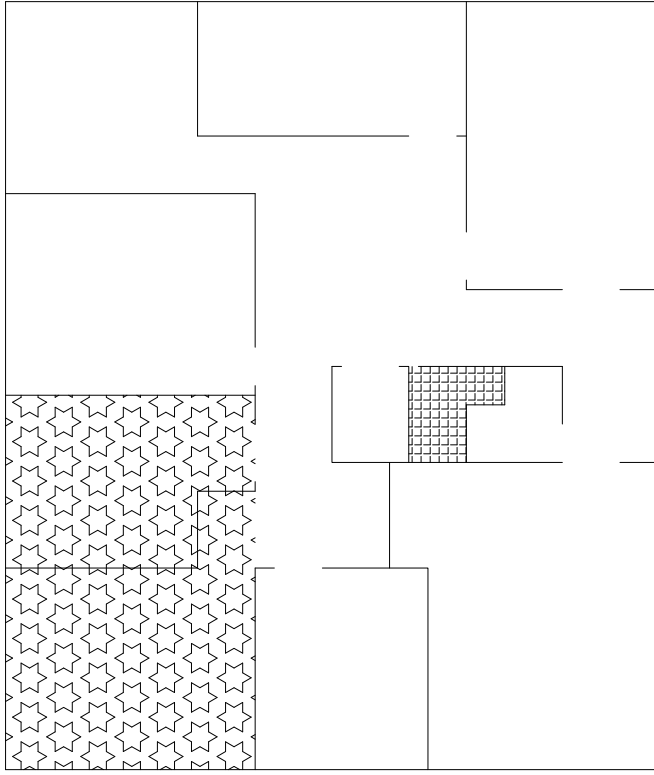

BASEMENT

GRANDE RIVER ENVIRONMENTAL, LLC


ACM Location Map - Flooring Basement Level
 439 South 2nd Street
 Montrose, Colorado

0 10
 APPROXIMATE SCALE (FEET)

Date: July 2015

Figure 1

LEGEND




Floor Tile and Mastic



Linoleum



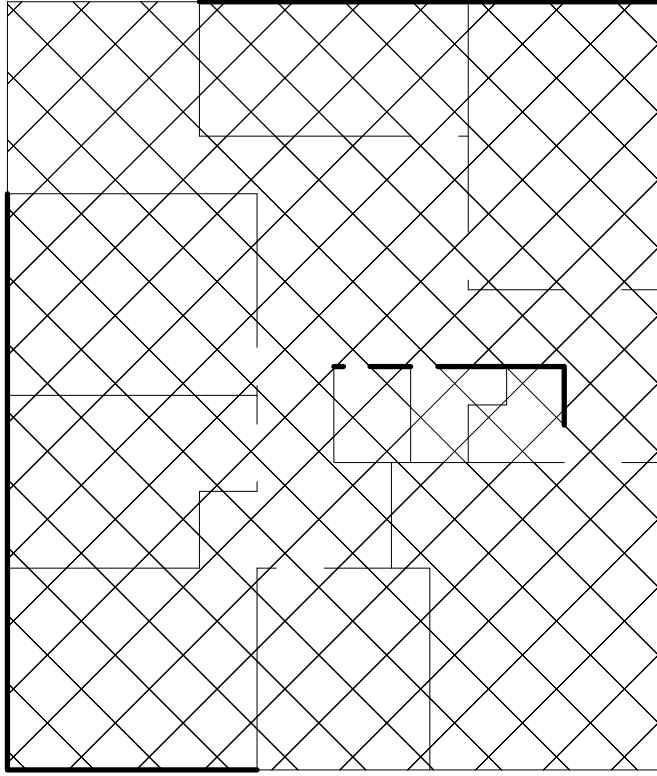

BASEMENT

Note: All other walls throughout the structure must be removed as ACM.

GRANDE RIVER ENVIRONMENTAL, LLC

ACM Location Map Basement
 439 South 2nd Street
 Montrose, Colorado

LEGEND


- Non ACM Drywall Walls To Remain
- ▣ Ceiling Tiles



Date: July 2015

Figure 2



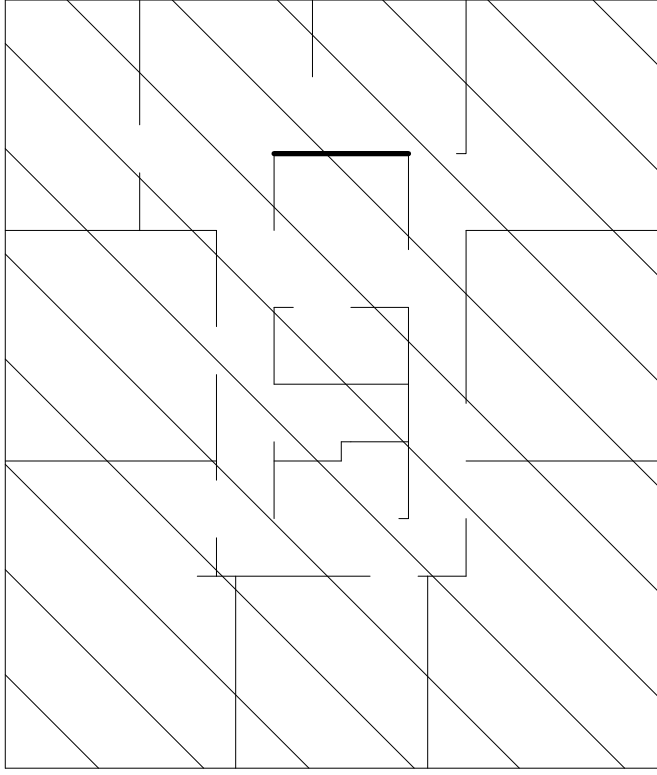

UPPER LEVEL

Note: All other walls throughout the structure must be removed as ACM.

GRANDE RIVER ENVIRONMENTAL, LLC

ACM Location Map Upper Level
 439 South 2nd Street
 Montrose, Colorado

LEGEND


-  Popcorn Ceiling Texture
-  Non ACM Drywall Walls To Remain

0 10
 APPROXIMATE SCALE (FEET)

Date: July 2015

Figure 3

Full Containment Boundary

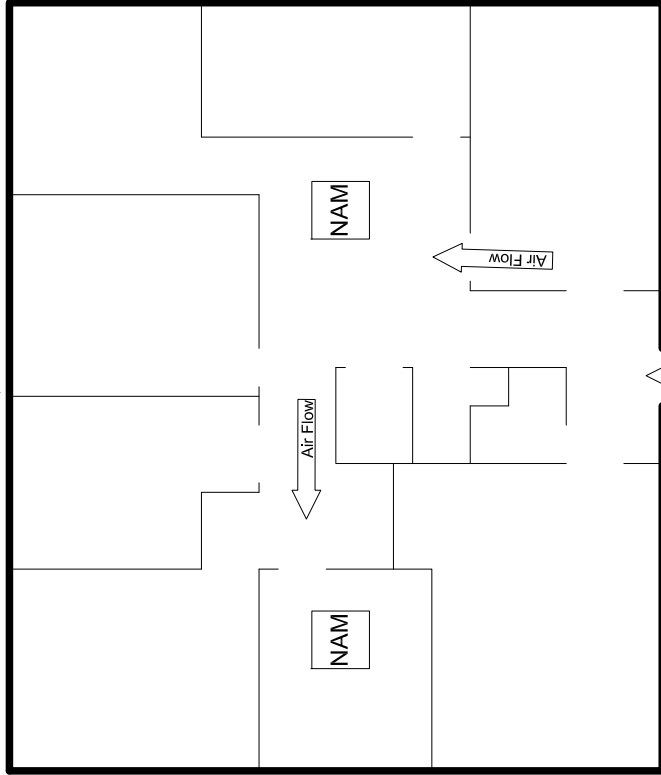


BASEMENT

SIZING AND SPECIFICATIONS FOR FULL CONTAINMENT

Containment Area	2,720 sq. ft.
Average Ceiling Height	10 ft.
Volume of Work Area	27,200 cu. ft.
Average CFM/ Machine	1,500 cfm
Air Changes per Hour	4
Machine Calculations	4
Contingency Factor	1
(1 or 25%; whichever is greater)	1
Total Negative Air Machines	5

Full Containment Boundary

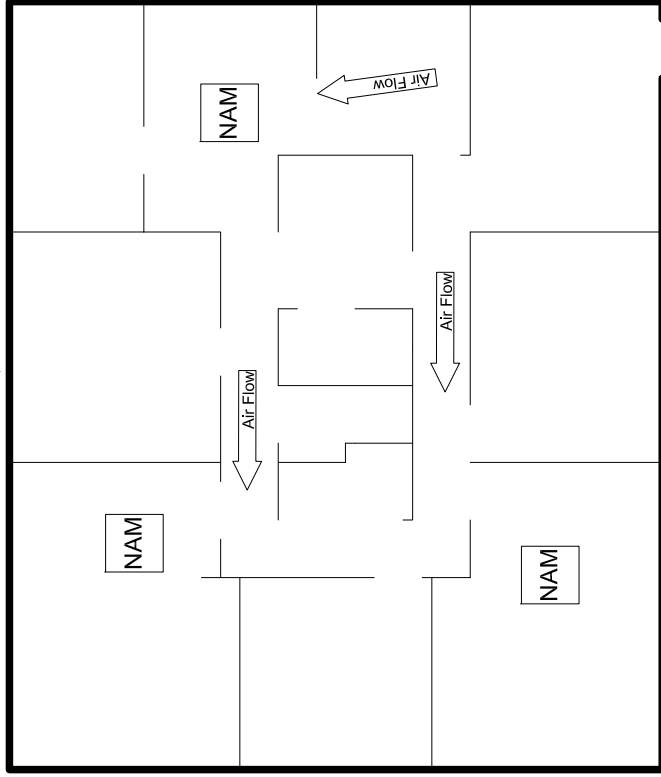

UPPER LEVEL

Scope of Work

Removal of approximately 1,360 square feet of popcorn ceiling texture, 7,744 square feet of drywall with texture from the walls, 1,360 square feet of ceiling tiles, 20 square feet of linoleum, 255 square feet of floor tile and mastic and 60 linear feet of caulking on South side basement level and all movable items within a full containment under a minimum negative air pressure of 0.020 inches of water. All removed materials shall be disposed as asbestos waste.

GRANDE RIVER ENVIRONMENTAL, LLC

Containment Configuration Map
 439 South 2nd Street
 Montrose, Colorado

0 10
 APPROXIMATE SCALE (FEET)


Date: July 2015

Figure 4

LEGEND



Negative Air Machine



Air Flow Direction



APPENDIX B

BID FORM



ASBESTOS ABATEMENT BID FORM

**STRUCTURE FOR RENOVATION
439 SOUTH 2nd STREET
MONTROSE, COLORADO**

The project consists of removal of asbestos-containing materials from the above-referenced residential structures prior to demolition. Details regarding the required abatement activities are presented in the document entitled *Asbestos Abatement Project Design* prepared by GRE dated July 16, 2015. The selected Contractor will enter into contract with the Owner. The project schedule will be provided by the OWNER.

Referencing the above-mentioned scope of work document prepared for this project, we hereby submit our bid in the amount stated in the blank of this bid form. Also the undersigned Bidder, having become thoroughly familiar with the terms and conditions of the document and with local conditions affecting performance and cost of the work at the place where the work is to be done, and having fully inspected the site in all particulars, hereby proposes and agrees to fully perform the work within the proposed schedule and by the specified deadline and in strict accordance with the contract for the following sum of money:

REMOVAL OF ACM AS SPECIFIED IN ABOVE REFERENCED SCOPE OF WORK:

Lump Sum Price for Removal of Specified Asbestos-Containing Materials:

_____ (\$ _____)

Bids include all labor, materials, services, equipment, insurance, bonds, security, etc, necessary for the completion of the work. The above listed price shall not be exceeded without approval by the Owner in the form of an approved change order request. The Owner reserves the right to accept any or all of the bid items. By requesting bids for the above-listed item, the Owner is not in any way obligated to award or conduct the projects.

COMMENTS: _____



UNIT RATES

Include costs for unit rates as indicated below. Assume you will already be onsite for determining your rates. If a mobilization is required to accomplish work using unit rates, the cost for mobilization will be added to the appropriate rate. Activities specified in the unit rates will be completed in accordance with the procedures outlined in these specifications and Colorado Regulation No. 8, Part B. Unit rates will be used to adjust the total project cost in the event of an increase or decrease in work activities included in the original scope of work. The rate to construct a full or secondary containment will be added to the cost to remove the specified material.

<i>UNIT PRICE LIST</i>		
DESCRIPTION	UNIT	PRICE PER UNIT
Drywall with Joint Compound and Texture	SF	
Linoleum on Concrete	SF	
Floor Tile and Mastic on Concrete	SF	
Drywall with Joint Compound and Popcorn Ceiling Texture	SF	
Ceiling Tiles	SF	
Window Caulking	LF	
<i>UNIT PRICE LIST</i>		
CONTAINMENT CONSTRUCTION		
DESCRIPTION	UNIT	PRICE PER UNIT
Full Containment <500 Square Feet	SF	
Full Containment >500 Square Feet	SF	
Secondary Containment <500 Square Feet	SF	
Secondary Containment >500 Square Feet	SF	
Mobilization/Demobilization	EVENT	
Water (Alternate) Do not include in Lump Sum	DAY	
Generator (Alternate) Do not include in Lump Sum	DAY	

NOTES: SF = square feet LF = linear feet

COMMENTS: _____



FIRM NAME AND ADDRESS:

SIGNED BY: _____ TITLE: _____

SIGNATURE: _____ DATE: _____

ATTESTED BY: _____ TITLE: _____

SIGNATURE: _____ DATE: _____

I understand the Owner reserves the right to reject this bid, and that this bid may not be withdrawn for a period of sixty (60) days after the bid opening date. I understand that if awarded the project, I will enter into and execute a contract on the basis of this bid. All work will be accomplished in accordance with contract documents and within specified calendar days after given notice to proceed. **I understand that required submittals specified in the Scope of Work Document must be submitted upon request by the Owner.**

By signing above I acknowledge that I have received the following addenda for the project.

I have received Addendum 1 (if applicable) _____ YES _____ NO

I have received Addendum 2 (if applicable) _____ YES _____ NO
