




MH R11-30-R

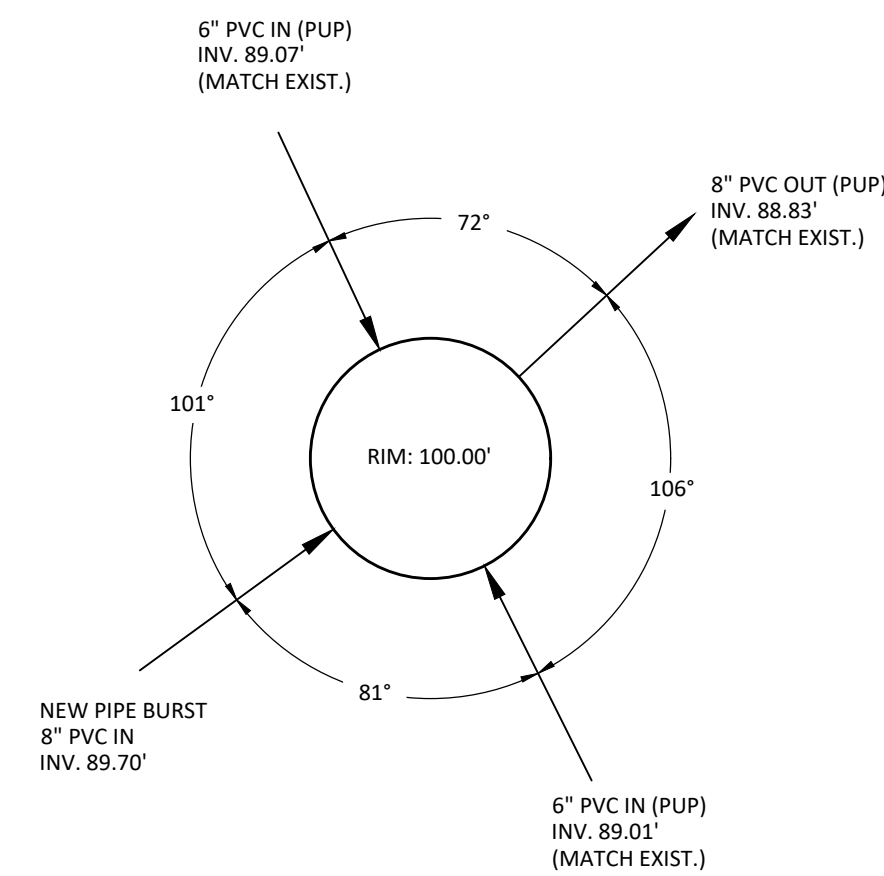


MH R11-33-R

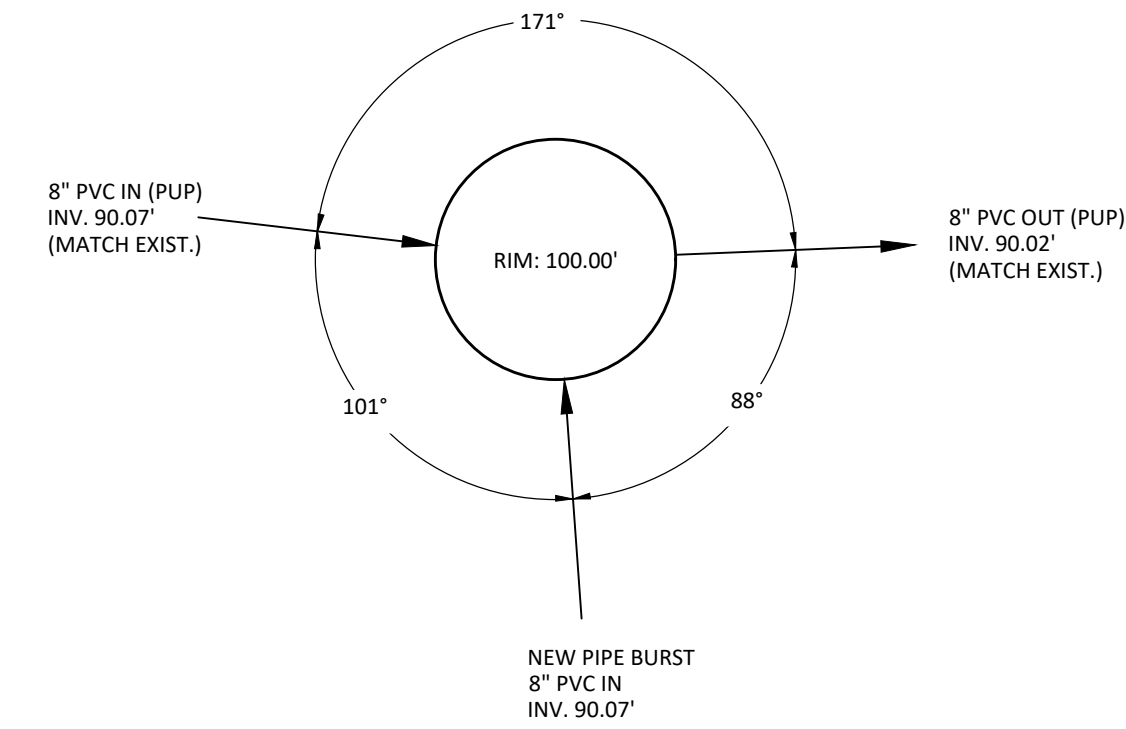


MH R11-38-R

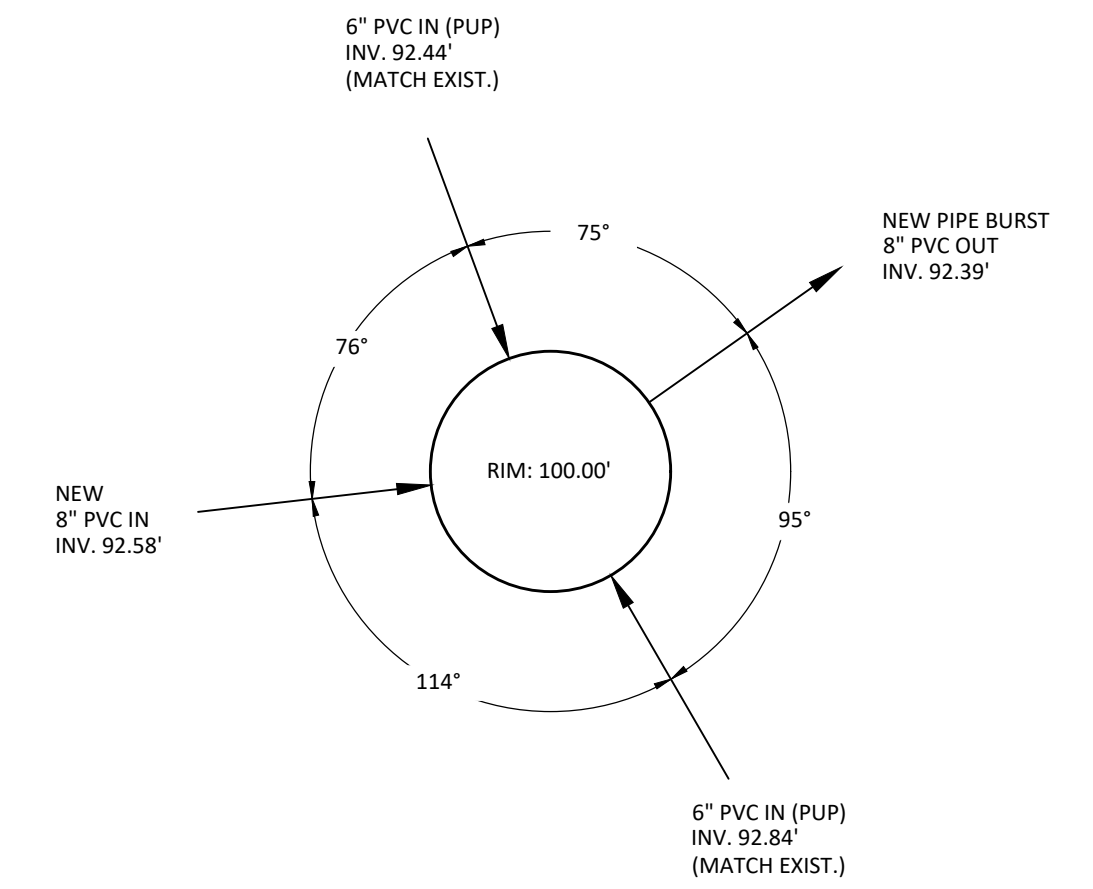


MH R11-40-R

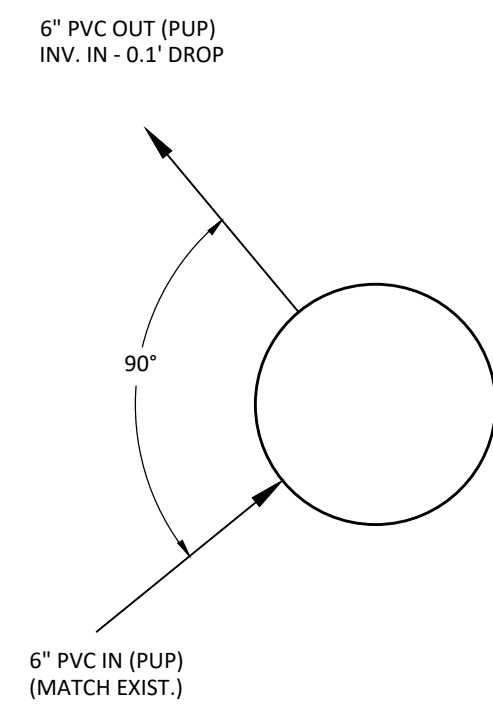


MH 1-1  
(INT. OF LINES 629 AND 795)  
CONTRACTOR TO VERIFY DEPTH

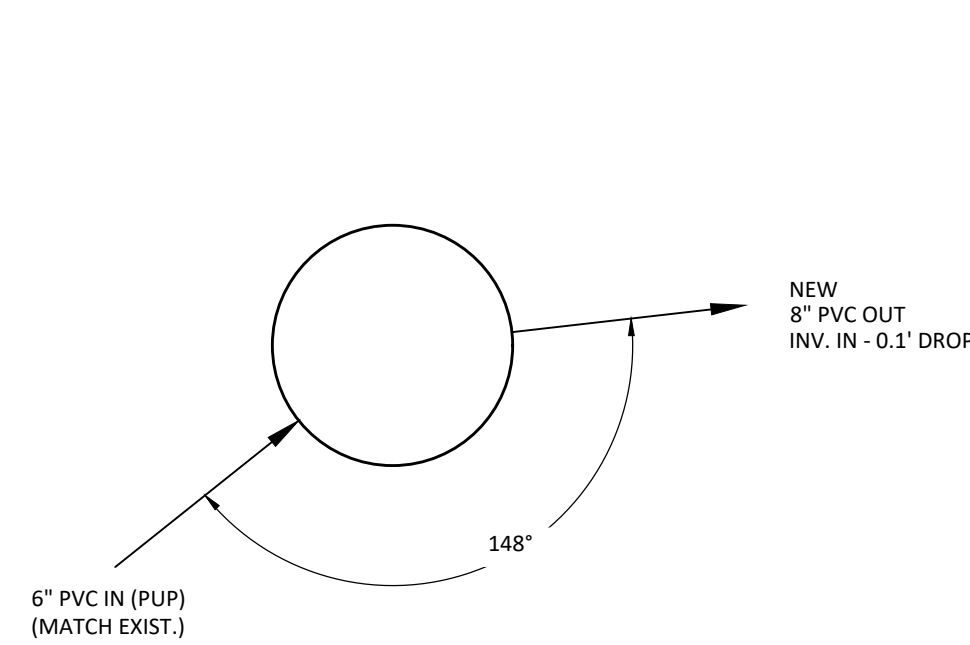


MH 2-1  
(UPSTREAM OF R11-40-R ON LINE 232)  
CONTRACTOR TO VERIFY DEPTH

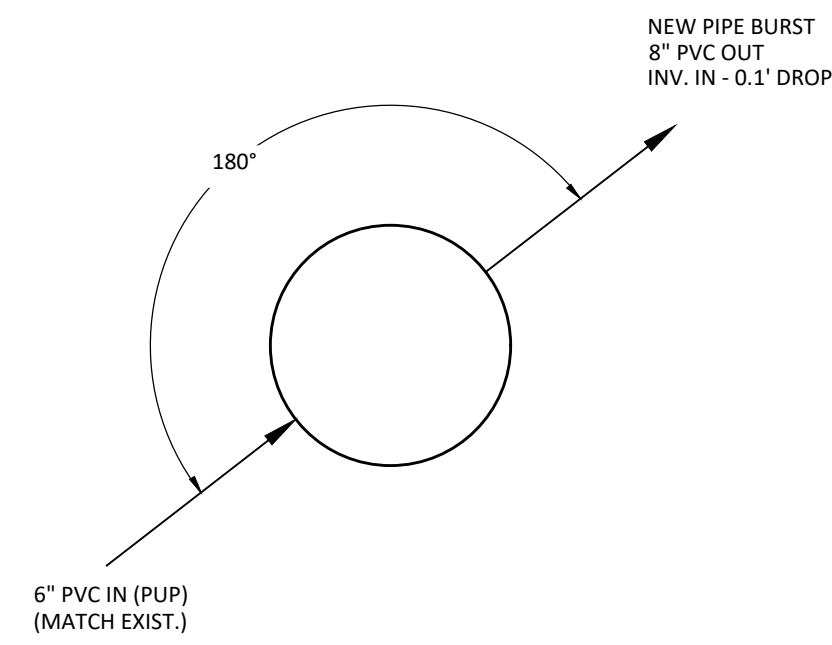

MH 3-1  
(INSERTION ON LINE 661)  
CONTRACTOR TO VERIFY DEPTH

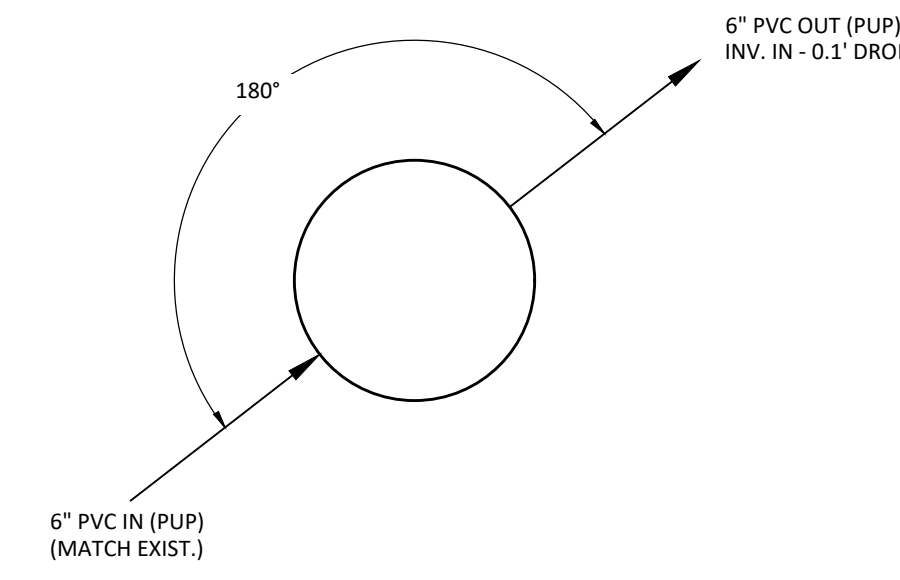


MH 4-1  
(INSERTION ON LINE 674)  
CONTRACTOR TO VERIFY DEPTH

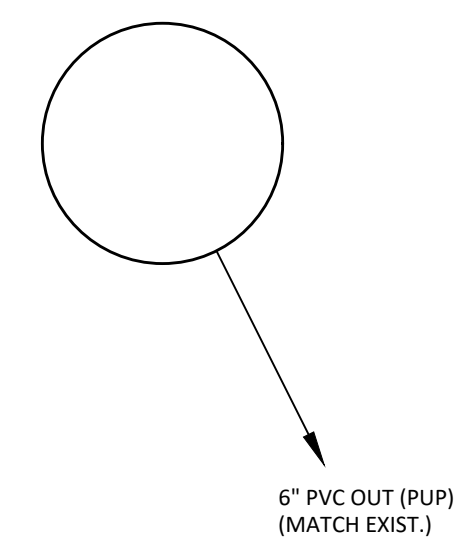

MH 5-1  
(INSERTION AT TOP OF LINE 2570)  
CONTRACTOR TO VERIFY DEPTH

- ADDITIONAL MANHOLE NOTES:
1. ALL MANHOLES SHALL BE 4' ID PRECAST CONCRETE PER CITY SPECS
  2. (PUP) REFERENCE REFERS TO THE SMALL PUP OF PIPE USED TO CONNECT EXISTING LINES TO THE NEW MANHOLE PER GENERAL NOTE SHEET. FOLLOWING MANHOLE REPLACEMENT AND RECONNECTION TO EXISTING LINES, CPP LINING SHALL EXTEND THROUGH THE ENTIRE PIPE (PUP PLUS EXISTING). IF NECESSARY TO EXTEND THE IN POINTS BEYOND THE LIMITS OF EXCAVATION FOR MANHOLE INSERTIONS AND REPLACEMENTS IN ORDER TO MAINTAIN POSITIVE GRADE, ADDITIONAL LENGTH WILL BE PAID BY THE LINEAR FOOT ON THE SPOT REPAIR LINE ITEM.
  3. ALL MANHOLE INVERTS (UP TO BENCH LEVEL) SHALL BE COATED WITH EPOXY COATING PER CITY SPECS TO IMPROVE SMOOTHNESS. COATING MAY BE APPLIED BY BRUSH, ROLLER, OR SPRAYER. APPLY COATING PER MANUFACTURER'S RECOMMENDATIONS.

**FOR BIDDING  
PURPOSES ONLY**  
NOT APPROVED FOR  
CONSTRUCTION

REFERENCE DRAWINGS		REVISIONS		 <b>CITY OF MONTROSE</b> ENGINEERING DEPARTMENT 1221 54th St MONTROSE, CO 81401 P.O. BOX 1480 FAX: 719-232-4780 WWW.CITYOFMONTROSE.ORG	DATE: 07/30/2020	WOODGATE SUBDIVISION SEWER SYSTEM REHABILITATION MONTROSE, COLORADO DETAILS	Sheet: 7
NAME	ISSUED FOR BID	RDC	DATE		JOB NO: 20.27.1		of: 7
	07/20/2020				DRAWN: RDC		
					DESIGN: RDC		
					CHECKED: SAM		
					SCALE: NTS		